

# Hooksett School Facilities



It has been two decades since the three public schools of the Hooksett School District underwent construction or major renovations.

- **Fred C. Underhill Elementary School** was constructed in 1958, last expanded in 1991, last renovated in 2006. It currently serves 448 students and 61+ staff in 52,000 sq. ft.
- **Hooksett Memorial School** was constructed in 1962, last renovated in 2003. It currently serves 396 students and 60+ staff in 82,250 sq ft.
- **David R. Cawley Middle School** was constructed in 2003. It currently serves 424 students and 69+ staff in 126,500 sq. ft.

+ the school district additionally utilizes contract staff


Audits of our three schools were completed in 2023, reviewing HVAC systems (heating, ventilation, and air conditioning), BMS controls (building management systems), the building envelope, windows, roof, electrical systems, fire alarm systems, domestic hot water systems, and kitchen equipment.

Some needed renovations:

- Two schools have 20 year-old roofs showing signs of water infiltration
- Boilers are 15-20 years old, are approaching service end of life, and are approx. 11% less efficient than modern units
- Two schools have issues with their building envelopes
- One school is in need of new windows
- Many ERVs (energy recovery ventilators) are 20 years old at end of service life, and could be replaced with units having dehumidification capabilities
- Two fire alarm systems are approaching recommended replacement age



## Hot Water Mixing Valve & Pressure Gauges

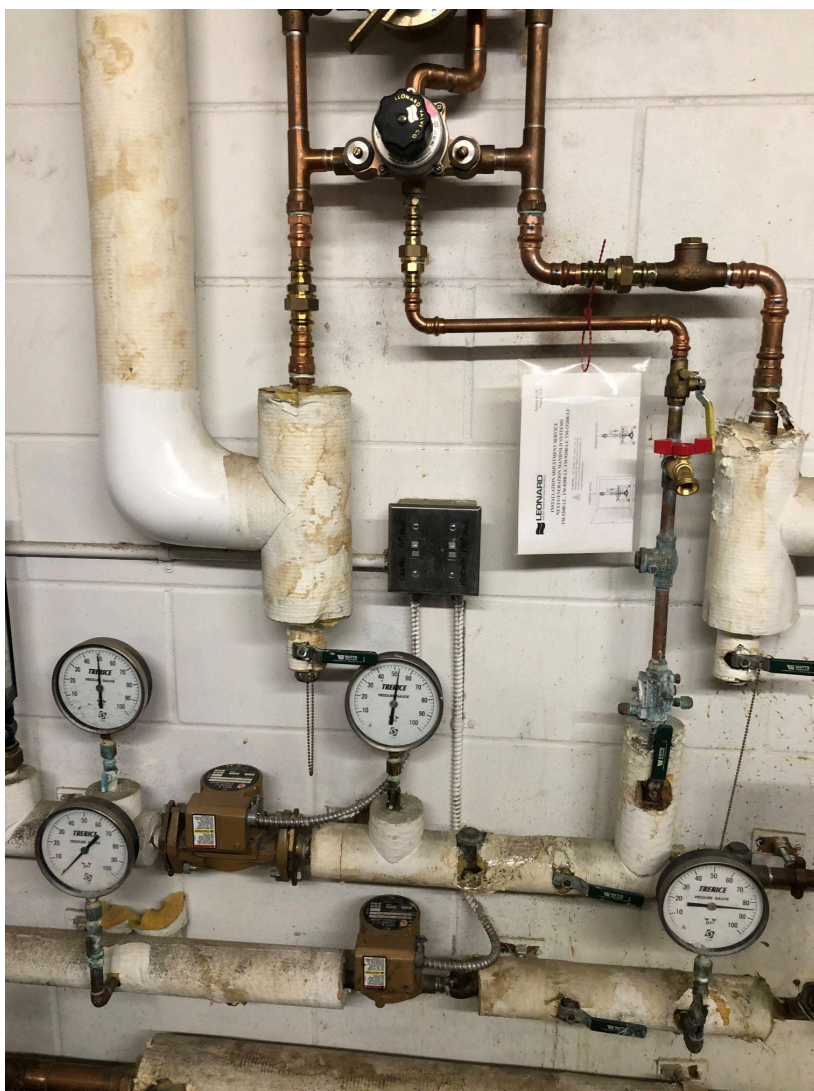

## Inefficient Boilers

